

## Legionella Risk Assessment

**Property address:**

9  
Grampian Court  
AVIEMORE  
PH22 1TB



**Client name:** Mr Andy Luke

**Assessor name:** Mr. Martin Anderson  
**Reference:** 000019  
**Assessment date:** 23/09/2022  
**Property type:** Flat

### Management responsibilities

**Name of Duty holder:** Mr Andy Luke  
**Name(s) of responsible person(s):** Mr Andy Luke

### Existing information

**Does a policy exist which clearly lays out individuals' responsibilities?** No  
**Are persons identified within the policy trained/competent?** Yes  
**Have contractors been approved and are they competent?** Yes  
**Does a written scheme of control currently exist for the property?** No  
**Has a schematic drawing been supplied by the client?** No

**Is property currently occupied?\*** No

*\* Please note that if the property is not occupied at time of inspection it is not possible to assess the risk of persons who may be vulnerable to Legionnaire's Disease. Therefore, the assessment will require review once the property is occupied. Properties which are unoccupied for periods of 2 weeks or more present a risk due to water stagnation- further details are contained in section 8 of this assessment.*

## Contents

About Legionella	3
The Law	3
Level of Risk	4
Details of Water System(s)	5
Water temperature at outlets	6
Cold water Storage	11
Hot water Storage	12
Little used/unused Outlets	14
Shower heads, taps and other spray outlets	15
Blind ends in pipework	18
Spa pools/hot tubs/whirlpool baths	19
Unoccupied properties	20
Tenants	21
High Risk groups	22
Further photos	23
Duties of Care for Legionella Control	29
Assessment Summary	30
Certificate of Compliance	31
Schematic Drawing of Water System	32

## About Legionella

Legionnaires' disease is a potentially fatal form of pneumonia which is contracted by inhaling small droplets of water containing the Legionella bacteria.

Legionella bacteria are present in low numbers in natural water systems such as rivers and ponds, and can be present in domestic and commercial hot and cold water systems. If conditions are favourable, the bacteria may multiply to dangerous levels in 9-10 days and it is possible to contract Legionnaires' disease, or the less harmful Pontiac Fever as a result of exposure to contaminated water.

Legionnaires' disease mainly affects people in 'high risk' groups including those over the age of 45, new born babies, smokers, heavy drinkers, those with heart disease and anyone who has a weakened immune system.

## The Law

The control of Legionella in rented property is a legal requirement, and duties of care are placed on Landlords as 'self-employed persons'. House of Commons Briefing Paper 07307 (October 2015) states that landlords have a responsibility to take measures to ensure that their properties are free from health and safety hazards, this includes taking measures to combat Legionnaires' Disease.

The duties of care placed on Landlords are detailed in the following generic HSE guidance and regulations:

- The Health and Safety at Work etc. Act 1974
- The Control of Substances Hazardous to Health Regulations 2002
- The Management of Health and Safety at Work Regulations 1999

Specific guidance on the control of Legionella bacteria is contained in the following publications:

- Legionnaires' Disease: The Control of Legionella Bacteria in Water Systems- Approved Code of Practice L8 2013 (HSE)
- Legionnaires' Disease: Part 2: The Control of Legionella Bacteria in Hot and Cold Water Systems HSG274 2014 (HSE)
- BS 8580-1:2019 Water quality. Risk assessments for Legionella control. Code of practice

## Level of Risk

The level of risk is determined by assessing the likelihood of a hazard occurring and the severity of the effects of the hazard. This Risk Assessment has been produced using a simple 6 level risk system as follows:

Rating	Risk Level	Details
<b>None</b>	No risk	There is no significant present risk and no action is currently required other than to ensure the risk assessment is reviewed at regular intervals.
<b>Minor</b>	Minor risk	There is a low risk but not under normal conditions. A written Scheme of Control is not required but could be implemented.
<b>Low</b>	Low risk	There is a low risk under normal conditions. A written Scheme of Control should be implemented and control measures detailed in this report followed
<b>Medium</b>	Medium risk	There is a significant risk but not under normal conditions. A written Scheme of Control is required and control measures recommended in this report should be followed, which may include changes to the design of the system.
<b>High</b>	High risk	There is a significant risk under normal conditions. A written Scheme of Control is required and control measures recommended in this report should be followed immediately, which may include changes to the design of the system and/or use of chemical disinfectants.
<b>Critical</b>	Critical risk	There is an immediate risk and urgent action is required. This may include isolation of the system and water sampling, and could include disinfection if necessary. A written Scheme of Control is required and control measures recommended in this report should be followed immediately. A further risk assessment is recommended following implementation of control measures.


Each risk factor is assessed individually and then an overall rating is given in the Assessment Summary section.

## Details of Water System(s)

<b>Scope of assessment</b>
Identify and check temperature of all cold and hot water outlets in property
<p><i>*Please note that inaccessible sections of pipework such as those situated under floors or recessed in walls have not been inspected as part of this risk assessment.</i></p> <p><i>This Legionella Competency Scheme only covers assessments of hot and cold water systems, not water bodies or water associated within HVAC(heating, ventilation, air conditioning) services.</i></p>
<b>Limitations</b>
None
<b>Type of hot and cold water system</b>
Pressurised
<b>Initial questions</b>
<p><b>Is water from a wholesome supply?</b> Yes</p> <p><b>Are all visible materials and fittings used suitable for application?</b> Yes</p>
<b>Brief overview of system including boiler/water heater, rooms served and outlets</b>
Electric Panel Heating, Electric Immersion Hot Water, Bathroom with sink, bath and electric shower, Kitchen sink.
<b>Description of current control strategy, if any</b>
N/A


## Water temperature at outlets

<b>1. Water temperature at outlets</b>
<p><b>Is cold water temperature below 20°C?</b> Yes</p> <p><b>Highest recorded temperature (°C)</b> 12</p> <p><b>Is hot water temperature above 50°C at outlets?</b> Yes</p> <p><b>Lowest recorded temperature(°C)</b> 56</p> <p><b>Are TMV's present?</b> No</p> <p><b>Is hot water temperature from TMVs (if fitted) 39-43°C at outlet(s)?</b> N/A</p>
<b>Issue(s) identified/comments</b>
Cold and Hot temperatures regular throughout property
<b>Risk rating</b>
<b>Risk level</b> 1 - Minor
<b>Recommendation(s)</b>
<b>Photo of water outlet</b>

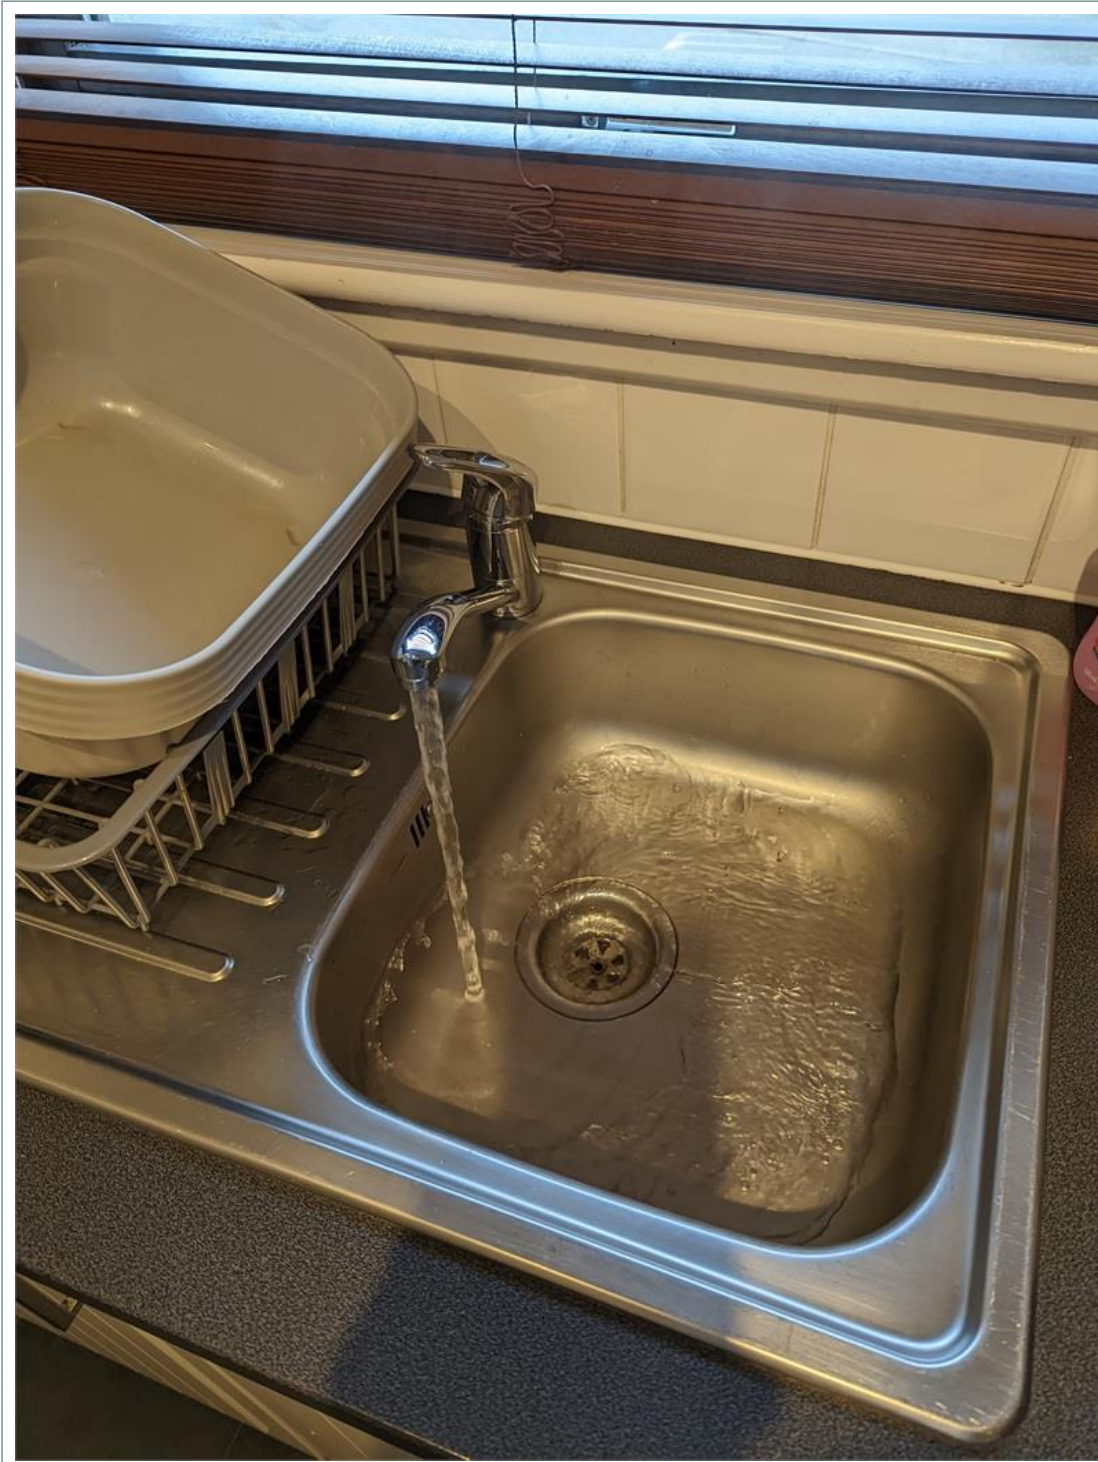





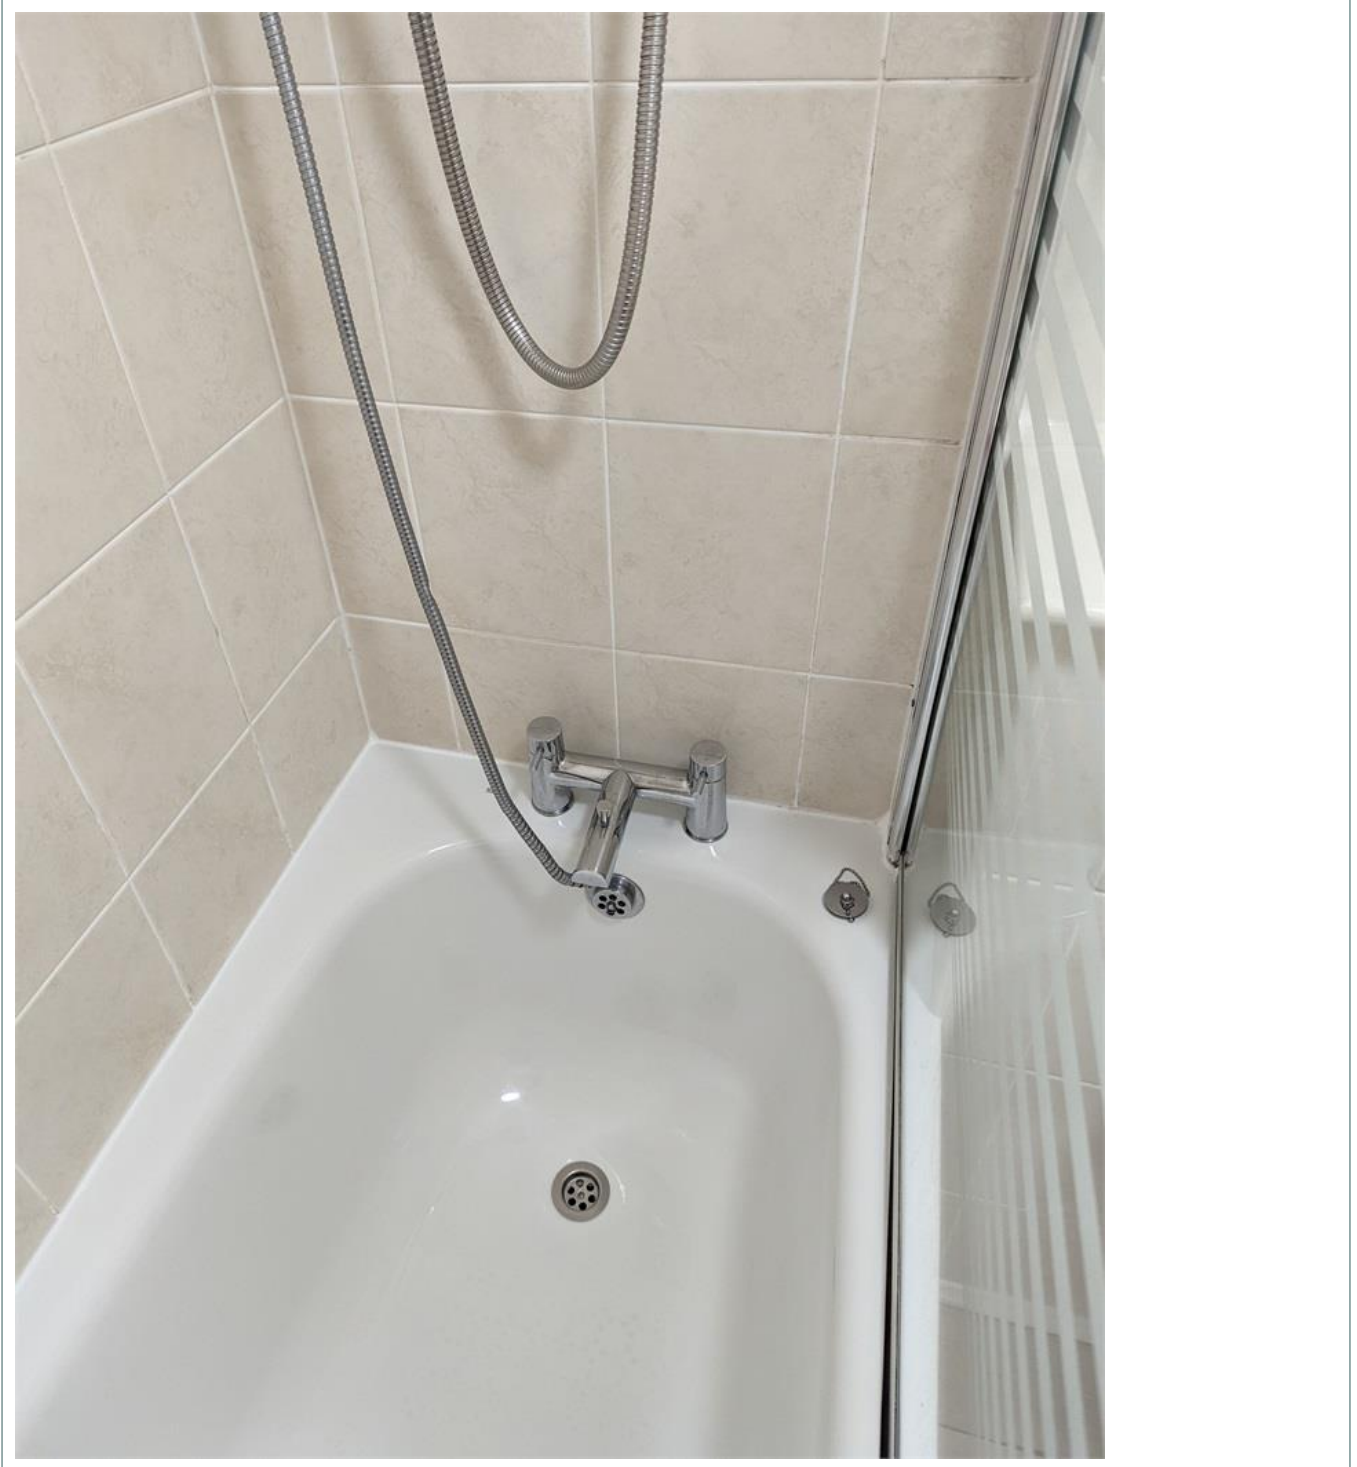



**GreenHighland**  
energy advice that matters



**0800 080 7367**

**07954 161482**



#### **Water temperature- control measures:**

*Ensure boiler/water heater is set to 60°C so that water reaches outlets at above 50°C. Ensure cold water does not exceed 20°C by making sure pipes and storage tanks are insulated. Ensure water temperature at outlets is 39-43°C where TMVs are fitted, or above 50°C at the hot pipe feeding the TMV if it is accessible. TMVs should be tested at least annually.*

## Cold water Storage

<b>2. Cold water storage</b>
<p><b>Is a cold water storage tank present?</b> No</p> <p><b>Is its location suitable?</b> N/A</p> <p><b>Does it have a close-fitting lid and is it compliant with HSE guidance?</b> N/A</p> <p><b>Is it insulated?</b> N/A</p> <p><b>Is water in the tank free from rust, biofilms, scale and debris?</b> N/A</p>
<b>Issue(s) identified/comments</b>
Mains-fed system - no cold water storage
<b>Risk rating</b>
<b>Risk level 1 - Minor</b>
<b>Recommendation(s)</b>
<b>Photo of cold water storage</b>
<p><b>Cold water storage- control measures:</b></p> <p><i>If rust is present on the tank it may require replacement. If debris, scale or biofilms are present in the tank it will require draining and cleaning out. A cold water tank should be constructed of a suitable material which is not prone to corrosion, have a close-fitting lid and comply with all other guidance given in document HSG 274, including being sufficiently insulated.</i></p>

## Hot water Storage

3. Hot water storage
<p>Is a hot water cylinder present? Yes</p> <p>Is the cylinder insulated? Yes</p> <p>Is a cylinder thermostat present? Yes</p> <p>Is the temperature on the cylinder thermostat set to 60°C or above? Yes</p> <p>Is the temperature of the flow pipe 60°C or above? Yes</p> <p>Is the temperature of the return pipe 50°C or above?(recirculating systems only) N/A</p> <p>Does the overflow from the calorifier go to a tundish or drain? N/A</p> <p>Does the storage vessel comply with relevant HSE guidance? Yes</p>
Issue(s) identified/comments
<p>Modern, well maintained Hot Water Tank</p>
Risk rating
<p><b>Risk level 1 - Minor</b></p>
Recommendation(s)
<p> </p>
Photo of hot water storage
<p> </p>



**Hot water storage- control measures:**

*Ensure hot water is stored at 60°C. The cylinder should be insulated to help maintain the correct temperature and to prevent heat loss. If a cylinder thermostat is fitted it should be set at the correct temperature and not adjusted. The overflow from a cylinder should go directly to a tundish or drain, not back into the cold water tank.*

## Little used/unused Outlets

### 4. Little used/unused outlets

Are there any outlets which are used less than once per week? No

### Issue(s) identified/comments

### Risk rating

Risk level 1 - Minor

### Recommendation(s)

### Photo of little used/unused outlets

### Little used/unused outlets control measures:

*Any little used outlets should be flushed through weekly by running the outlet for at least two minutes. Spray/aerosol production should be minimised when carrying this out. Consideration should also be given to removing little used outlets and dead legs (pipes leading to an outlet through which water flows but the outlet is unused/rarely used) where possible.*

## Shower heads, taps and other spray outlets

<b>5. Shower heads, taps and other spray outlets</b>
<p><b>Are there any showers present?</b> Yes</p> <p><b>Are there any spray taps present?</b> No</p> <p><b>Is there a hose pipe present?</b> No</p>
<b>Issue(s) identified/comments</b>
Electric shower and Shower hear from taps. Both very clean and well-maintained
<b>Risk rating</b>
<b>Risk level</b> 1 - Minor
<b>Recommendation(s)</b>
<b>Photo of Shower heads, taps and other spray outlets</b>







**Shower heads and other spray outlets- control measures:**

*Any showers/spray/taps/hose pipes should be flushed through weekly. Shower heads and other outlets should be de-scaled at least every 3-6 months. Consideration should be given to replacing spray taps with normal taps.*

## Blind ends in pipework

### 6. Blind ends in pipework

**Are there any blind ends (lengths of redundant pipework which have been capped off) present?** No

### Issue(s) identified/comments

### Risk rating

**Risk level** 0 - None

### Recommendation(s)

### Photo of Blind ends in pipework

### Blind ends in pipework- control measures:

*Any blind ends in pipework should be removed to ensure water cannot stagnate in the water system.*

## Spa pools/hot tubs/whirlpool baths

<b>7. Spa pools/hot tubs/whirlpool baths</b>
<p><b>Is a spa pool/hot tub present?</b> No</p> <p><b>Is a whirlpool bath present?</b> No</p>
<b>Issue(s) identified/comments</b>
<b>Risk rating</b>
<b>Risk level</b> 0 - None
<b>Recommendation(s)</b>
<b>Photo of Spa pools/hot tubs/whirlpool baths</b>
<p><b>Spa pools/hot tubs/whirlpool baths- control measures:</b></p> <p><i>Spa pools/hot tubs and whirlpool baths should be cleaned and disinfected in accordance with manufacturers' guidelines, along with regular visual inspection.</i></p>

## Unoccupied properties

<b>8. Unoccupied properties</b>
<b>Is the property unoccupied for periods longer than two weeks?</b> Unknown
<b>Issue(s) identified/comments</b>
Property is a holiday let - no access to occupancy levels
<b>Risk rating</b>
<b>Risk level 1 - Minor</b>
<b>Recommendation(s)</b>
<p><b>Unoccupied properties control measures:</b></p> <p><i>If the property is unoccupied for periods of longer than 2 weeks all hot and cold water outlets systems should be flushed through at least weekly for at least two minutes. For longer periods consideration should be given to draining the system completely. The system should be flushed through before it is re-occupied by running all outlets for at least two minutes. Spray/aerosol production should be minimised during this process.</i></p>

## Tenants

9. Tenants
<p><b>Are tenants aware of the risks of Legionnaire's Disease?</b> Unknown  <b>Are tenants aware of their responsibilities to minimise this risk?</b> Unknown</p>
Issue(s) identified/comments
Risk rating
<b>Risk level 1 - Minor</b>
Recommendation(s)
<p><b>Tenants- control measures:</b></p> <p><i>Tenants should be given an advice document informing them of the risks of Legionnaire's Disease from hot and cold water systems, as well as relevant information relating to the system in place. They should be advised not to alter hot water temperatures on boilers/water heaters and/or cylinders.</i></p>

## High Risk groups

10. High risk groups
<p><b>Is the property occupied by persons vulnerable to Legionellosis?</b> Unknown  <b>Are there any regular visitors to the property who are vulnerable?</b> Unknown</p>
Issue(s) identified/comments
Property is a holiday let
Risk rating
<b>Risk level 1 - Minor</b>
Recommendation(s)
<p><b>High risk groups- control measures:</b></p> <p><i>The presence of vulnerable tenants and regular visitors to the property should be re-evaluated on change of occupancy. TMVs may need to be installed where vulnerable persons are at risk of scalding. Consideration should also be given to removing unnecessary spray outlets such as spray taps.</i></p>

## Further photos

### Further photos















## Duties of Care for Legionella Control

**Landlord/ Managing Agent responsibilities include the following:**

- Ensure hot and cold water systems are maintained as per the guidance contained in the Control Measures sections of this report and detailed in HSE document HSG 274 Part 2
- Ensure stored hot water is heated to 60°C or above and all hot water reaches outlets at 50°C
- Flush through hot and cold water systems prior to letting if a property has been unoccupied for 2 weeks or more (respiratory protection is advised during this process)
- Provide tenants with written information about the risks of Legionella and the correct operation of the hot and cold water system installed in the property

**Tenant Responsibilities (if appropriate and detailed in tenancy agreement) include:**

- Regular cleaning of shower heads, taps and other spray outlets every 3-6 months
- Flushing through of any little used/unused outlets every 1-2 weeks
- Reporting of any issues identified with the hot and cold water system
- Ensuring heating controls are not altered from their required settings

## Assessment Summary

Summary of Risk Assessment
No immediate risks encountered, all elements within are clean and well-maintained. Temperatures of cold and hot water are well within guidelines
Overall Risk Rating
<b>Risk level 1 - Minor</b>
Assessment review date
<i>*This risk assessment should be reviewed on change of occupancy or changes to the water system.</i>

Disclaimer
<p>This risk assessment has been carried out using information provided by the client and the property's occupants at the time of assessment. It is hereby understood and agreed that the person/s named in this risk assessment shall not be liable in respect of any claim or costs or expenses arising out of the following:</p> <ul style="list-style-type: none"> <li>Any neglect, error or omission occurring or committed prior to the date of this document in respect of Legionella risk assessments</li> <li>The collection of water samples for Legionella testing, the cleaning of water systems, Legionella testing and/or putting in place physical Legionella controls.</li> </ul>

Further information on Legionella control is available in the following publications, which are available to download free from the HSE website [www.hse.gov.uk](http://www.hse.gov.uk)

- Legionnaires' Disease: The Control of Legionella Bacteria in Water Systems- Approved Code of Practice L8 (2013) HSE*
- Legionnaires' Disease: Part 2: The Control of Legionella Bacteria in Hot and Cold Water Systems HSG274 (2014) HSE*



**GreenHighland**  
energy advice that matters

 **0800 080 7367**   **07954 161482**

Certificate

## Certificate of Compliance

Legionella Risk Assessment

*For*

**9, Grampian Court, AVIEMORE, PH22  
1TB**

**Assessor's accreditation number:** EES/016601  
**Assessor's Name:** Mr. Martin Anderson  
**Email:** [info@greenhighland.org](mailto:info@greenhighland.org)  
**Assessment Date:** 23/09/2022

This Legionella risk assessment has been produced by a competent assessor in accordance with the requirements of Approved Code of Practice L8, HSG 274 Part 2 and other relevant HSE guidance. If you have any queries with this certificate please contact the assessor that produced it in the first instance, their details are shown above.

Elmhurst Energy Systems Limited

Elmhurst Energy Systems Limited  
16 St Johns Business Park,  
Lutterworth, Leicestershire, LE17 4HB

T: 01455 883 250  
F: 08715 289 419  
E: [existingdwellings-support@Elmhurstenergy.co.uk](mailto:existingdwellings-support@Elmhurstenergy.co.uk)  
W: [www.elmhurstenergy.co.uk](http://www.elmhurstenergy.co.uk)

## Schematic Drawing of Water System

